



```
EUC\MGB\MGB_EN_IP_R_127866.ema
Variant A
Multi-line
V1.0
==Safety=Safety_systems++MGB_EN_IP-127866/126636.a
```

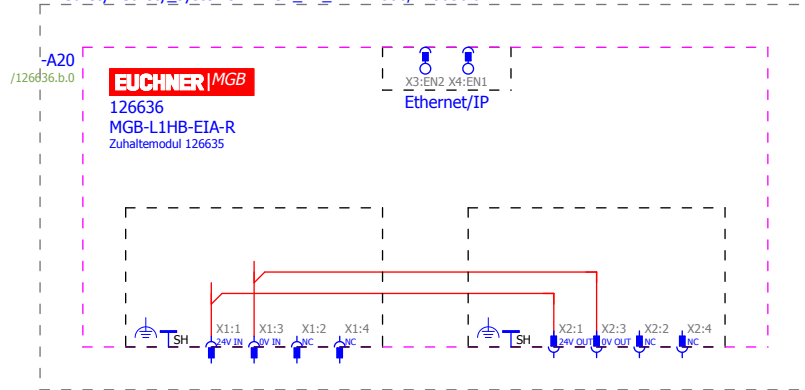

EUC\MGB\MGB_EN_IP_R_127866.ema
Variant B
Multi-line
V1.0
==Safety=Safety_systems++MGB_EN_IP-127866/126636.a

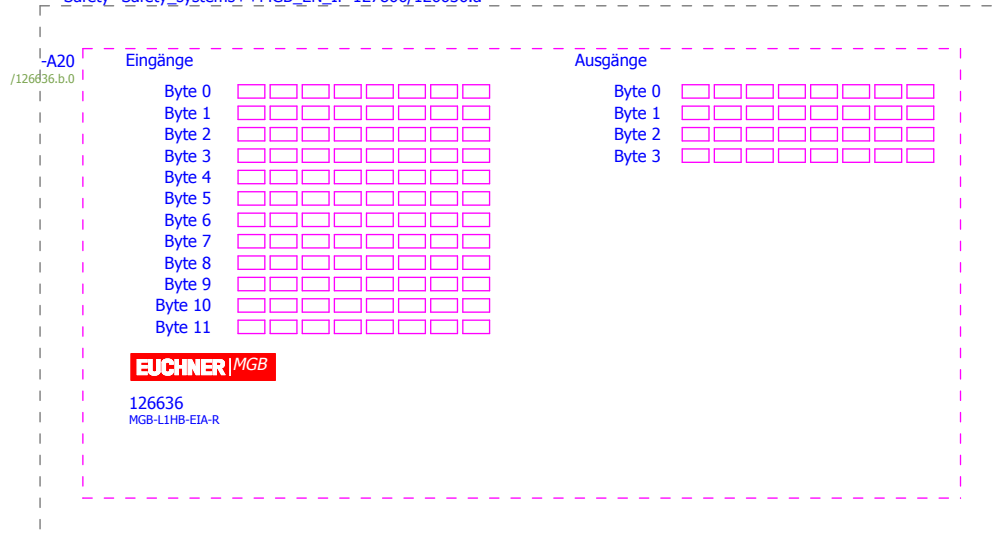




			Datum	08.06.16	<div></div>		Artikelnummer:	126636.a	Typ: Eplan Makro	= Safety_systems
		Bearb.	avara	++ MGB_EN_IP						
		Gepr								
Änderung	Datum	Name	Urspr		Ersatz von	Ersetzt durch				

Connection Header	
Byte 0	
E2153.0	RunMode
E2153.1	ConnectionFaulted
E2153.2	DiagnosticActive
E2153.3	n.c.
E2153.4	n.c.
E2153.5	n.c.
E2153.6	n.c.
E2153.7	n.c.
Byte 1	
E2154.0	DSC00
E2154.1	DSC01
E2154.2	DSC02
E2154.3	DSC03
E2154.4	DSC04
E2154.5	DSC05
E2154.6	DSC06
E2154.7	DSC07
<div style="display: flex; align-items: center;"> <div style="font-size: 3em; margin-right: 10px;">}</div> <div> Diagnostic Sequence Count (8 Bit Wert) </div> </div>	
Byte 2	
E2155.0	n.c.
E2155.1	n.c.
E2155.2	n.c.
E2155.3	n.c.
E2155.4	n.c.
E2155.5	n.c.
E2155.6	n.c.
E2155.7	n.c.
E2156.0	n.c.
E2156.1	n.c.
E2156.2	n.c.
E2156.3	n.c.
E2156.4	n.c.
E2156.5	n.c.
E2156.6	n.c.
E2156.7	n.c.

MGB-B

Diagnosemodul

Auswertemodul	Byte 0	A1818.0	<input type="text"/>	FO.L (Zuhaltung)
	A1818.1	<input type="text"/>	n.c.	
	A1818.2	<input type="text"/>	n.c.	
	A1818.3	<input type="text"/>	n.c.	
	A1818.4	<input type="text"/>	n.c.	
	A1818.5	<input type="text"/>	n.c.	
	A1818.6	<input type="text"/>	n.c.	
	A1818.7	<input type="text"/>	n.c.	
Busmodul	Byte 1	A1819.0	<input type="text"/>	n.c.
	A1819.1	<input type="text"/>	n.c.	
	A1819.2	<input type="text"/>	n.c.	
	A1819.3	<input type="text"/>	n.c.	
	A1819.4	<input type="text"/>	n.c.	
	A1819.5	<input type="text"/>	n.c.	
	A1819.6	<input type="text"/>	n.c.	
	A1819.7	<input type="text"/>	n.c.	
Auswertemodul	Byte 2	A1820.0	<input type="text"/>	LED; H1
	A1820.1	<input type="text"/>	LED; H2	
	A1820.2	<input type="text"/>	LED; H3	
	A1820.3	<input type="text"/>	n.c.	
	A1820.4	<input type="text"/>	n.c.	
	A1820.5	<input type="text"/>	n.c.	
	A1820.6	<input type="text"/>	n.c.	
	A1820.7	<input type="text"/>	n.c.	
Diagnosemodul	Byte 3	A1821.0	<input type="text"/>	n.c.
	A1821.1	<input type="text"/>	n.c.	
	A1821.2	<input type="text"/>	n.c.	
	A1821.3	<input type="text"/>	n.c.	
	A1821.4	<input type="text"/>	n.c.	
	A1821.5	<input type="text"/>	n.c.	
	A1821.6	<input type="text"/>	Q.G (Quittieren Busfehler)	
	A1821.7	<input type="text"/>	Q.P.F (Quittieren Plausibilitätsfehler)	



EUC\MGB\MGB_EN_IP_R_127866.ema
Variant B
Overview
V1.0
==Safety==Safety_systems++MGB_EN_IP-127866/126636.c

