



EUC\MGB\MGB_PNC_R_115631.ema
Variant A
Multi-line
V1.0
==Safety=

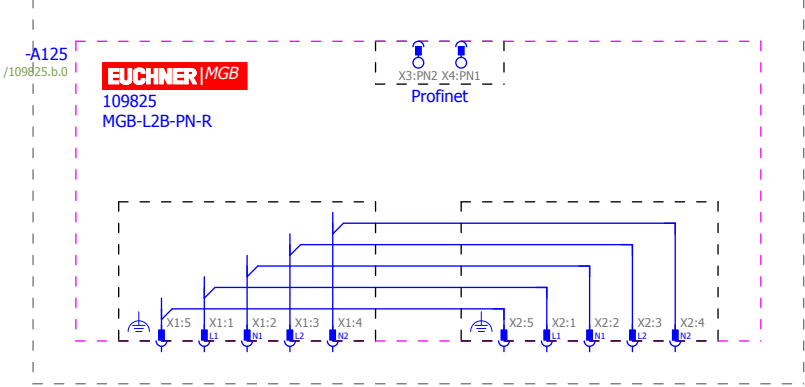

EUC\MGB\MGB_PNC_R_115631.ema
Variant B
Multi-line
V1.0
==Safety=

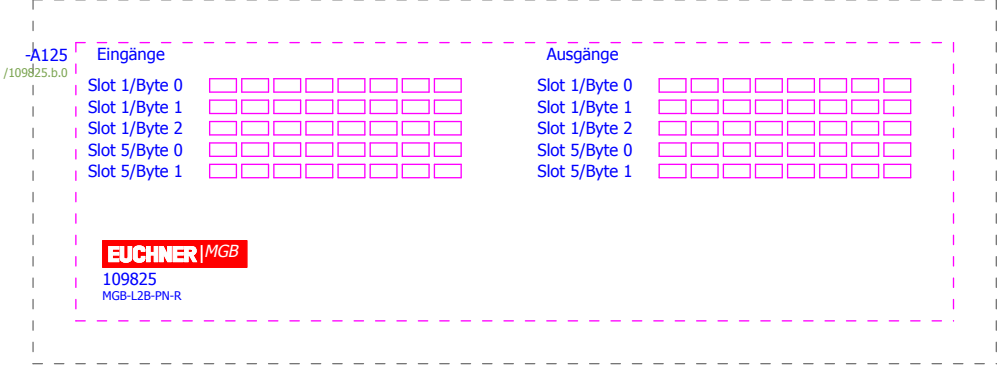

-A125
/109825.a.1
/109825.a.1


Eingänge

Profinet	Slot 1 / Byte 0		PROFIsafe	Slot 5 / Byte 0	
	E2507.0	<input type="checkbox"/> n.c.		E2510.0	<input type="checkbox"/> Not-Halt
	E2507.1	<input type="checkbox"/> n.c.		E2510.1	<input type="checkbox"/> n.c.
	E2507.2	<input type="checkbox"/> n.c.		E2510.2	<input type="checkbox"/> T (Türstellung)
	E2507.3	<input type="checkbox"/> n.c.		E2510.3	<input type="checkbox"/> R (Riegelstellung)
	E2507.4	<input type="checkbox"/> n.c.		E2510.4	<input type="checkbox"/> Z (Zuhaltung)
	E2507.5	<input type="checkbox"/> n.c.		E2510.5	<input type="checkbox"/> n.c.
	E2507.6	<input type="checkbox"/> n.c.		E2510.6	<input type="checkbox"/> n.c.
	E2507.7	<input type="checkbox"/> S8 Taster		E2510.7	<input type="checkbox"/> n.c.
	Slot 1 / Byte 1			Slot 5 / Byte 1	
E2508.0	<input type="checkbox"/> S9 Taster	E2511.0	<input type="checkbox"/> SK (T UND R)		
E2508.1	<input type="checkbox"/> n.c.	E2511.1	<input type="checkbox"/> ÜK (T UND R UND Z)		
E2508.2	<input type="checkbox"/> n.c.	E2511.2	<input type="checkbox"/> n.c.		
E2508.3	<input type="checkbox"/> n.c.	E2511.3	<input type="checkbox"/> n.c.		
E2508.4	<input type="checkbox"/> n.c.	E2511.4	<input type="checkbox"/> n.c.		
E2508.5	<input type="checkbox"/> n.c.	E2511.5	<input type="checkbox"/> n.c.		
E2508.6	<input type="checkbox"/> n.c.	E2511.6	<input type="checkbox"/> n.c.		
E2508.7	<input type="checkbox"/> n.c.	E2511.7	<input type="checkbox"/> n.c.		
Slot 1 / Byte 2					
E2509.0	<input type="checkbox"/> Meldung liegt an. Profisafe				
E2509.1	<input type="checkbox"/> Meldung 274(4)				
E2509.2	<input type="checkbox"/> Meldung 272(1) oder 273(1)				
E2509.3	<input type="checkbox"/> n.c.				
E2509.4	<input type="checkbox"/> n.c.				
E2509.5	<input type="checkbox"/> n.c.				
E2509.6	<input type="checkbox"/> n.c.				
E2509.7	<input type="checkbox"/> Meldung 274(1)				

Ausgänge

Profinet	Slot 1 / Byte 0		PROFIsafe	Slot 5 / Byte 0	
	A1990.0	<input type="checkbox"/> n.c.		A1993.0	<input type="checkbox"/> Zuhaltemagnet - Steuerspannung ein
	A1990.1	<input type="checkbox"/> n.c.		A1993.1	<input type="checkbox"/> n.c.
	A1990.2	<input type="checkbox"/> n.c.		A1993.2	<input type="checkbox"/> n.c.
	A1990.3	<input type="checkbox"/> n.c.		A1993.3	<input type="checkbox"/> n.c.
	A1990.4	<input type="checkbox"/> n.c.		A1993.4	<input type="checkbox"/> n.c.
	A1990.5	<input type="checkbox"/> n.c.		A1993.5	<input type="checkbox"/> n.c.
	A1990.6	<input type="checkbox"/> n.c.		A1993.6	<input type="checkbox"/> n.c.
	A1990.7	<input type="checkbox"/> LED; H8		A1993.7	<input type="checkbox"/> n.c.
	Slot 1 / Byte 1			Slot 5 / Byte 1	
A1991.0	<input type="checkbox"/> LED; H9	A1994.0	<input type="checkbox"/> n.c.		
A1991.1	<input type="checkbox"/> n.c.	A1994.1	<input type="checkbox"/> n.c.		
A1991.2	<input type="checkbox"/> LED; H7	A1994.2	<input type="checkbox"/> n.c.		
A1991.3	<input type="checkbox"/> n.c.	A1994.3	<input type="checkbox"/> n.c.		
A1991.4	<input type="checkbox"/> n.c.	A1994.4	<input type="checkbox"/> n.c.		
A1991.5	<input type="checkbox"/> n.c.	A1994.5	<input type="checkbox"/> n.c.		
A1991.6	<input type="checkbox"/> n.c.	A1994.6	<input type="checkbox"/> n.c.		
A1991.7	<input type="checkbox"/> Zuhaltemagnet	A1994.7	<input type="checkbox"/> n.c.		
Slot 1 / Byte 2					
A1992.0	<input type="checkbox"/> Gerätediagnose: Meldung quittieren				
A1992.1	<input type="checkbox"/> Reset MGB Zuhaltemodul: Meldung quittieren				
A1992.2	<input type="checkbox"/> n.c.				
A1992.3	<input type="checkbox"/> n.c.				
A1992.4	<input type="checkbox"/> n.c.				
A1992.5	<input type="checkbox"/> n.c.				
A1992.6	<input type="checkbox"/> n.c.				
A1992.7	<input type="checkbox"/> n.c.				

EUCHNER | MGB
109825
MGB-L2B-PN-R



EUC\MGB\MGB_PNC_R_115631.ema
Variant B
Overview
V1.0
==Safety==Safety_systems++MGB_PN+PNC-115631/109825.c

